
WIRING DIAGRAM: SMALL EQUIPMENT ENCLOSURE2(SECONDARY/REMOTE)



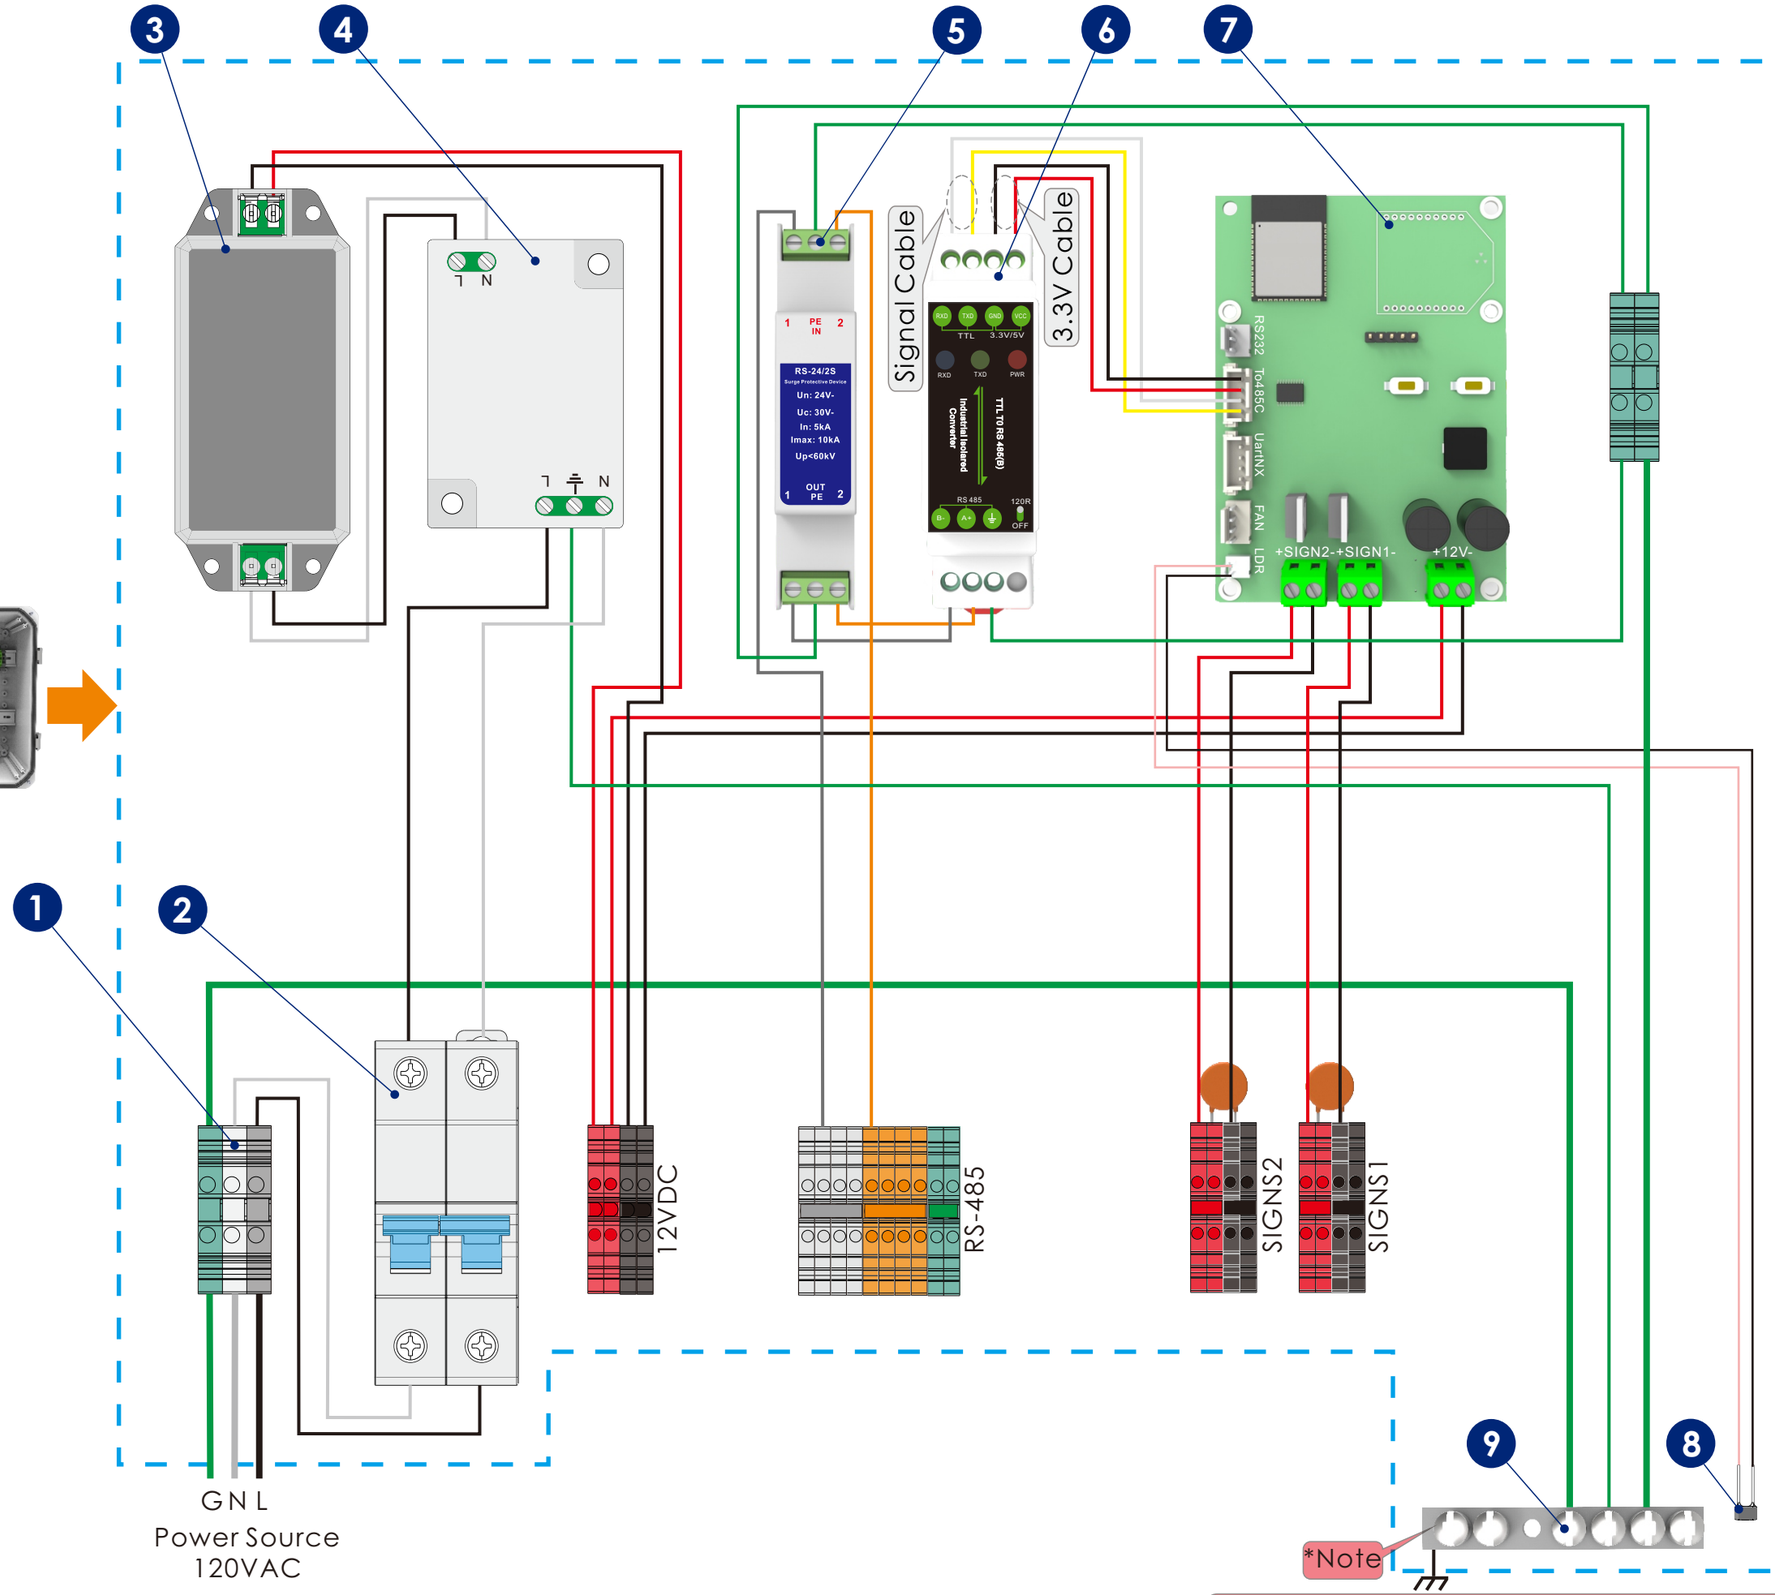

*Note: The ground bar must be connected to a ground rod upon installation.

CABLE INFORMATION

120VAC LIVE (L)	
NEUTRAL (N)	
GROUND(G)	
+12VDC	
−12VDC	
+RS-485	
−RS-485	
+PHOTO CELL	
−PHOTO CELL	

No.	NAME
1	TERMINAL BLOCKS
2	BREAKER
3	AC/12VDC CONVERTER
4	SPD
5	RS-485 SPD
6	RS-485 CONVERTER
7	CONTROLLER
8	PHOTO CELL
9	GROUND BAR

GC-HS-SECONDARY/REMOTE
Wiring Diagram for Secondary/Remote Highlighted Sign Enclosures for AC

TYPICAL EQUIPMENT CONFIGURATION
FOR AN AC POWERED
WRONG-WAY VEHICLE DETECTION SYSTEM

govcomm

WIRING DIAGRAM: SMALL EQUIPMENT ENCLOSURE2

GC-ENC-AR