
WIRING DIAGRAM: SMALL EQUIPMENT ENCLOSURE1(PRIMARY)

*Note: The ground bar must be connected to a ground rod upon installation.



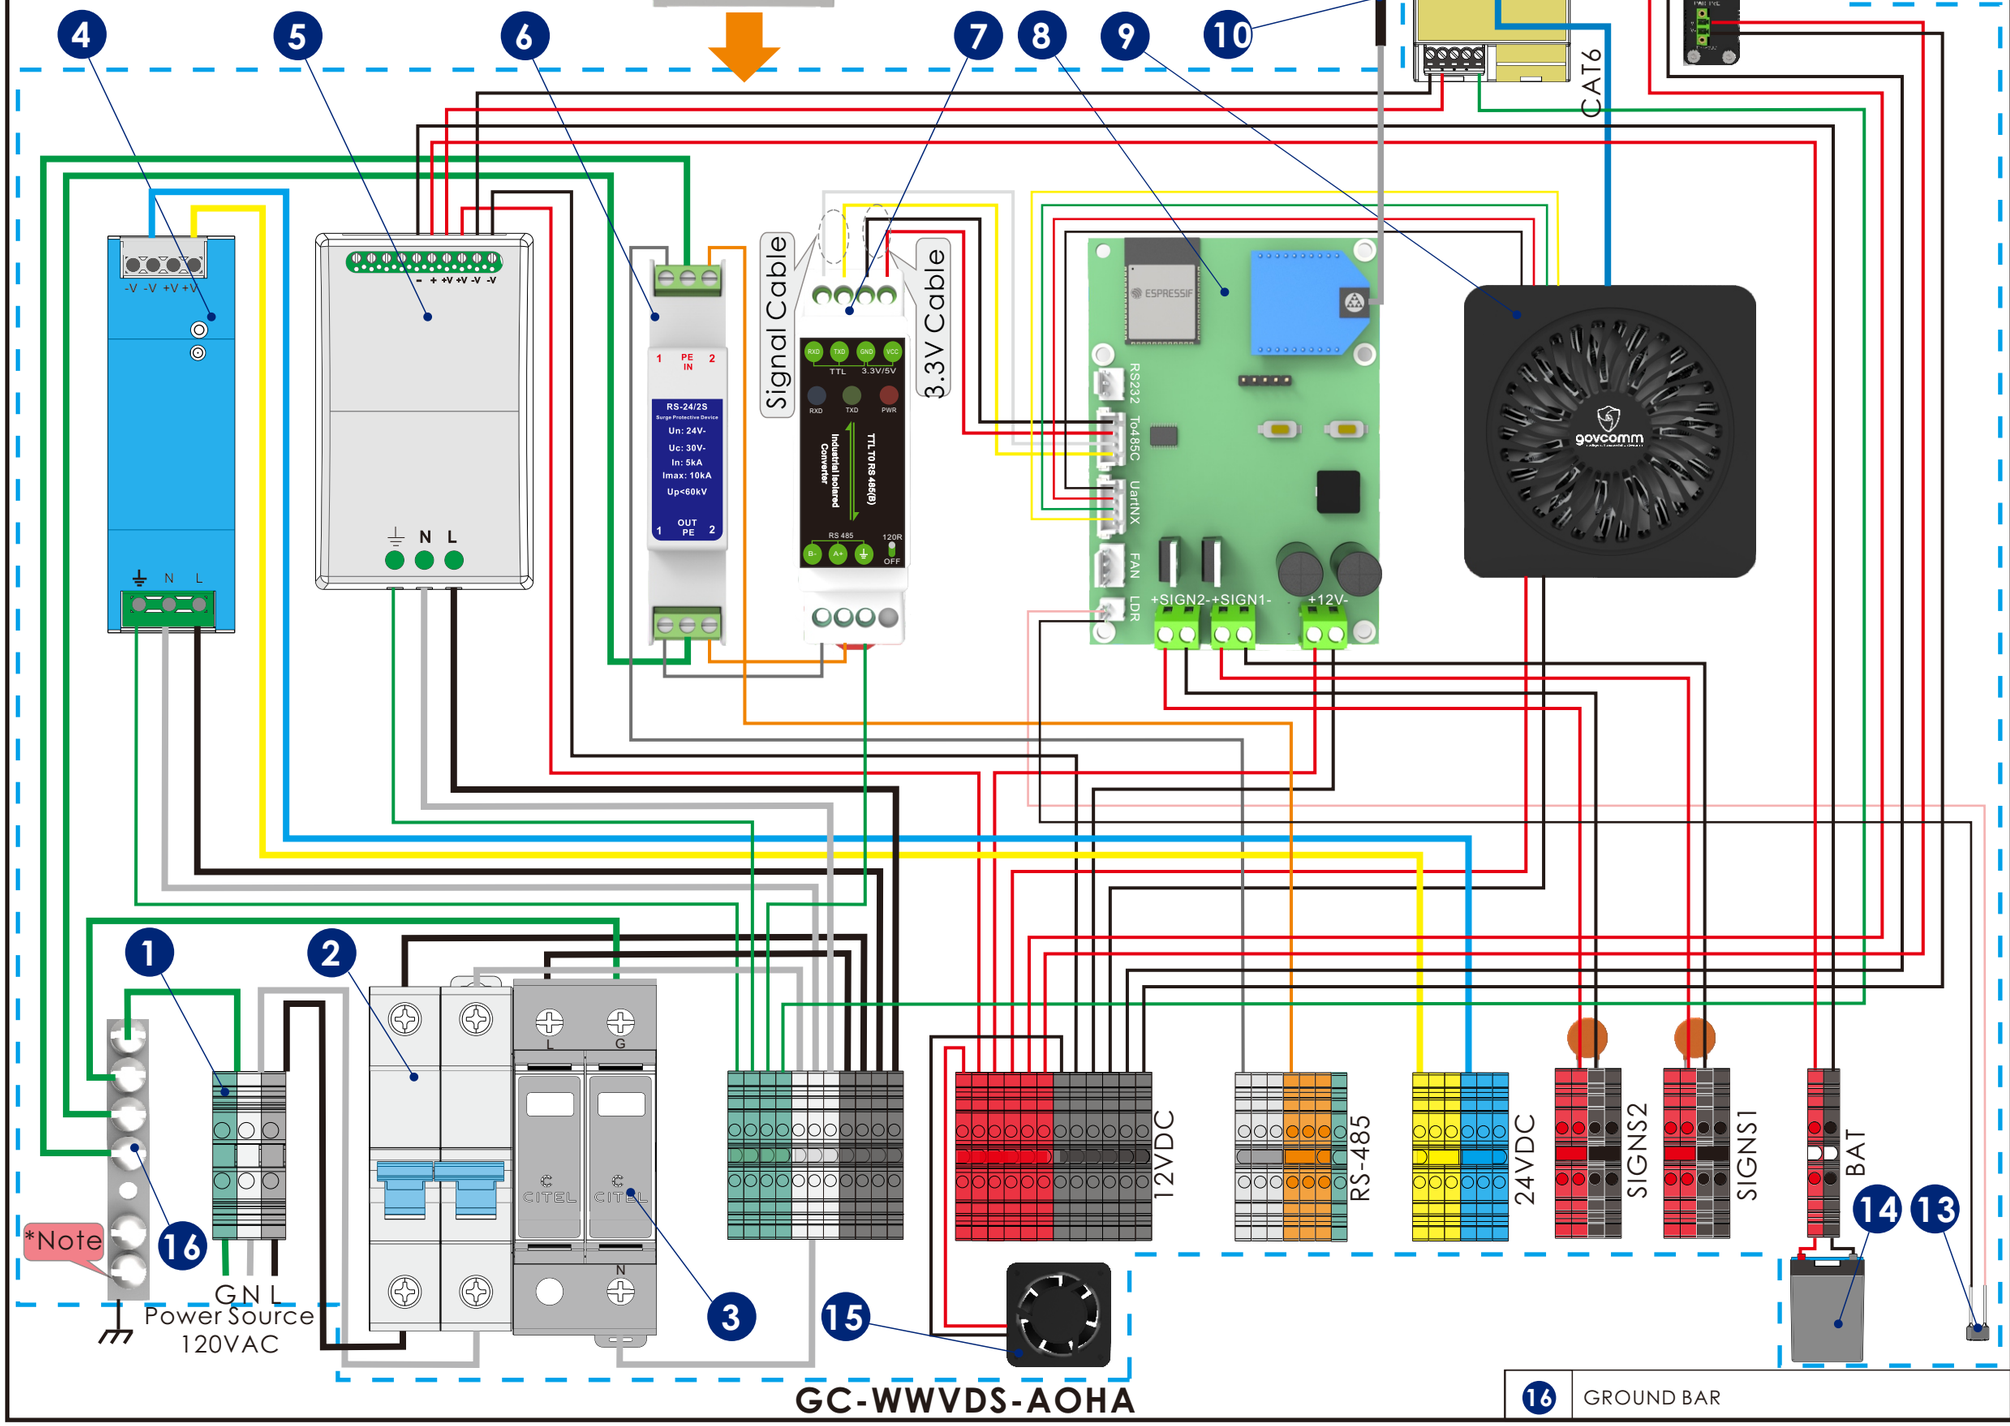

CABLE INFORMATION

120VAC LIVE (L)	
NEUTRAL (N)	
GROUND(G)	
NETWORK CABLE	
SIGNAL CABLE	
+12VDC CABLE	
−12VDC CABLE	
+24VDC CABLE	
−24VDC CABLE	
PHOTO CELL CABLE	
PHOTO CELL CABLE	
+RS-485	
−RS-485	

No.	NAME
1	TERMINAL BLOCKS
2	BREAKER
3	SPD
4	AC/24VDC CONVERTER
5	AC/12VDC CONVERTER
6	RS-485 SPD
7	RS-485 CONVERTER
8	CONTROLLER
9	COMPUTER MODULE
10	ANTENNA
11	UNMANAGED NETWORK SWITCH
12	PoE INJECTOR
13	PHOTO CELL
14	BATTERY
15	FAN
16	GROUND BAR

GC-WWVDS-SERIES

Wiring Diagram for Small Equipment Enclosure1

TYPICAL EQUIPMENT CONFIGURATION FOR AN AC POWERED WRONG-WAY VEHICLE DETECTION SYSTEM

govcomm

WIRING DIAGRAM: SMALL EQUIPMENT ENCLOSURE1