
Wiring Diagram for WWVDS in ITS Cabinet

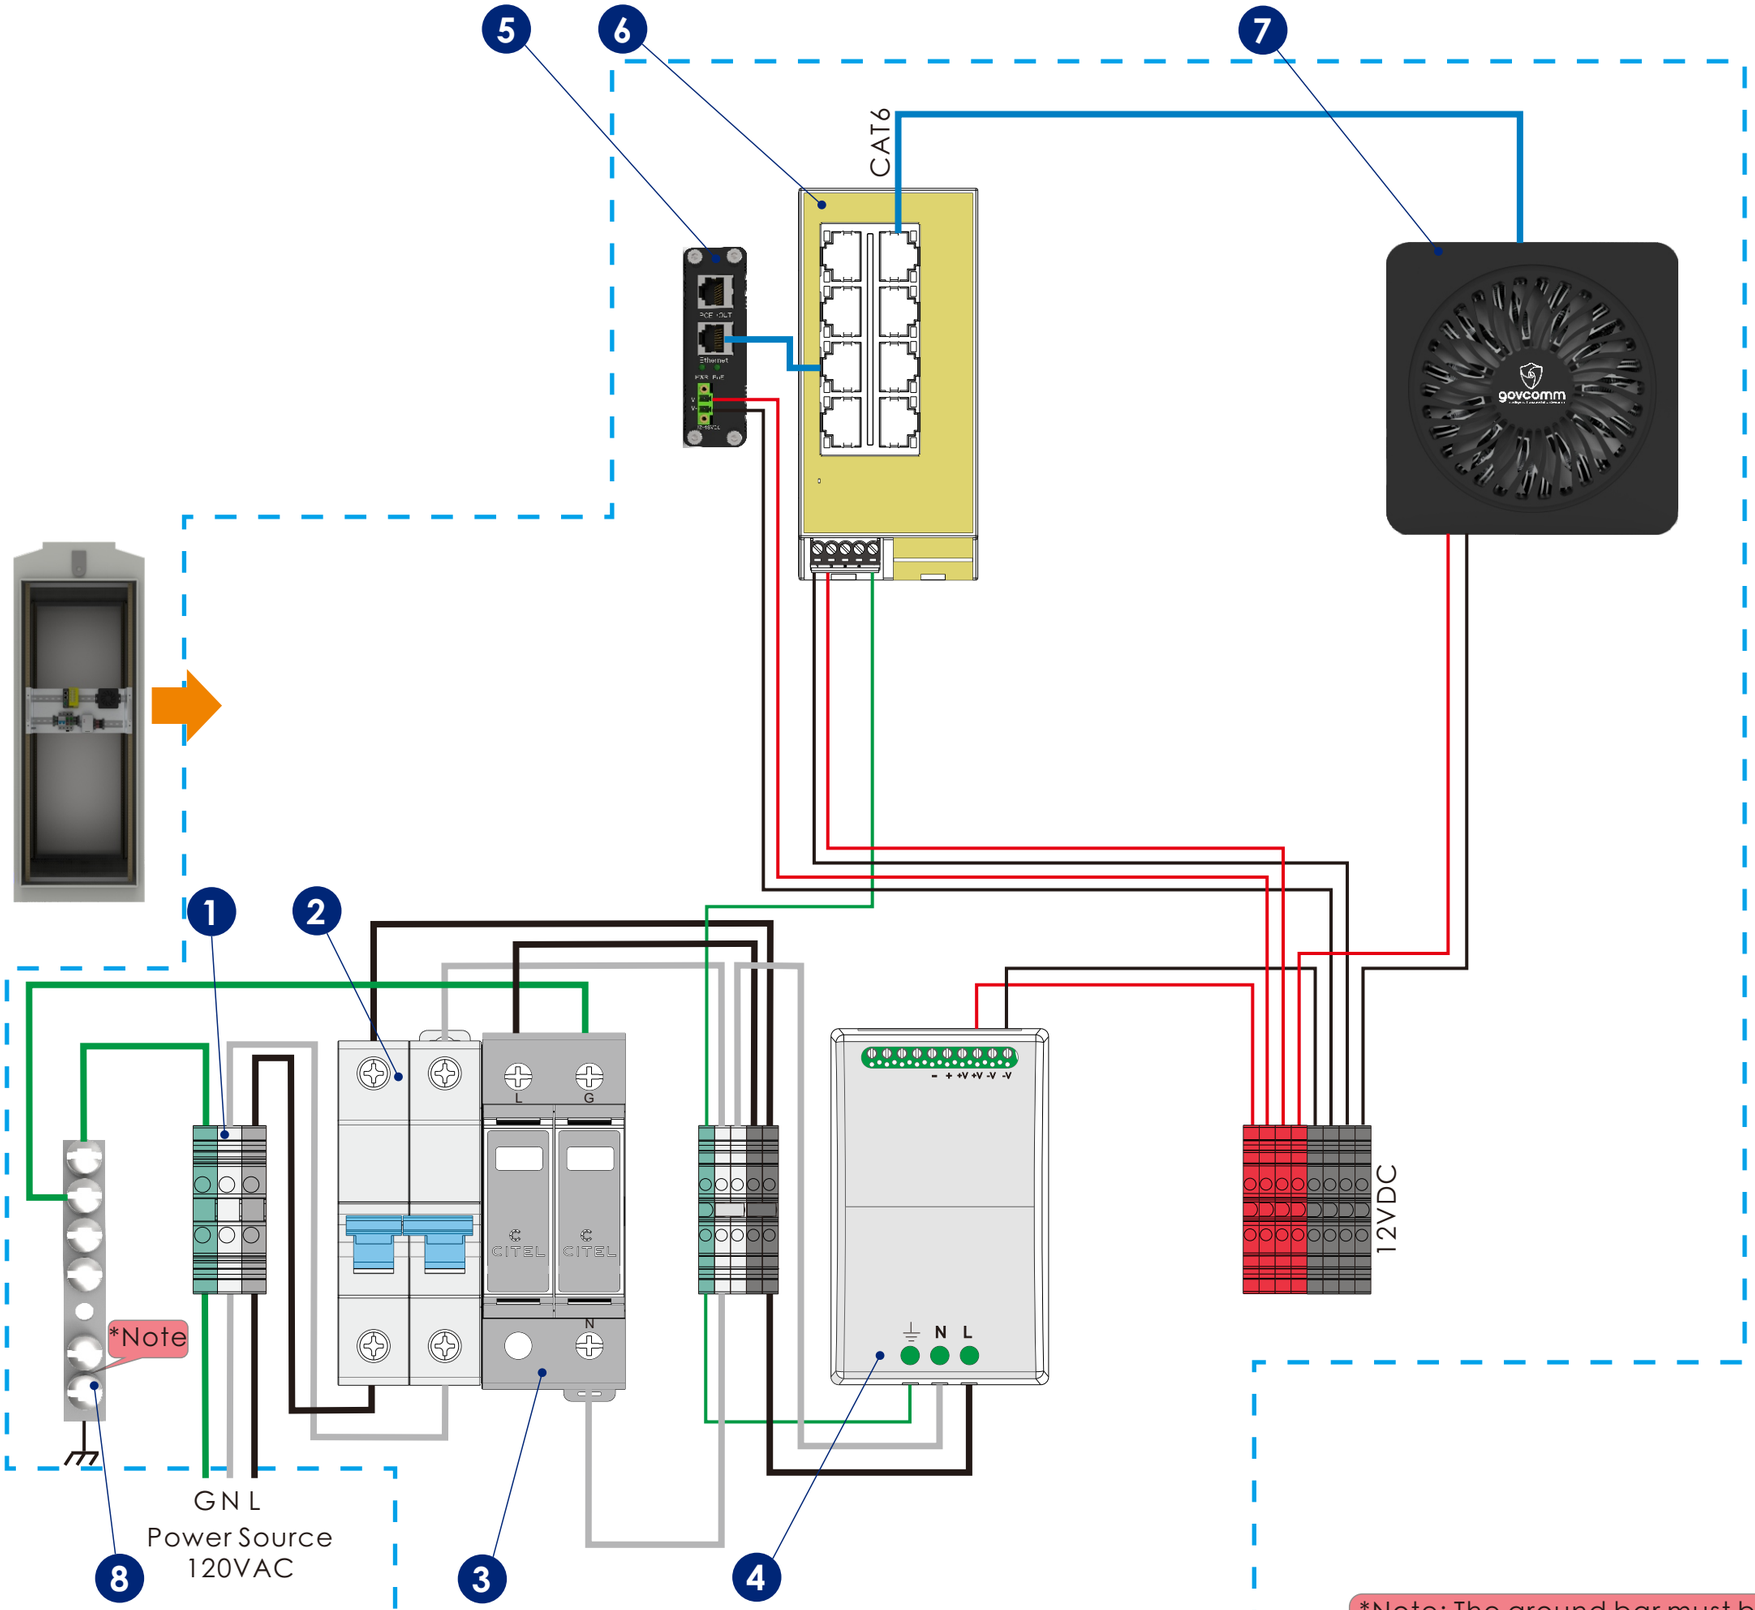

*Note: The ground bar must be connected to a ground rod upon installation.

CABLE INFORMATION

120VAC LIVE (L)	
NEUTRAL (N)	
GROUND(G)	
NETWORK CABLE	
+12VDC CABLE	
−12VDC CABLE	

No.	NAME
1	TERMINAL BLOCKS
2	BREAKER
3	SPD
4	AC/12VDC CONVERTER
5	PoE INJECTOR
6	UNMANAGED NETWORK SWITCH
7	COMPUTER MODULE
8	GROUND BAR

GC-WWVDS-SERIES

Wiring Diagram for WWVDS in ITS Cabinet

TYPICAL EQUIPMENT CONFIGURATION FOR AN AC POWERED WRONG-WAY VEHICLE DETECTION SYSTEM

govcomm

WIRING DIAGRAM: RECESSED PLATE